




DETAILS FOR UNDERGROUND CABLE DUCT/CONDUIT INSTALLTION

Note: Effective 8/1/2022 South Central Power Co. (SCP) no longer approves the direct bury or sand embedment of underground facilities. All underground facilities shall be installed in an approved conduit/duct system. This change is to ensure the longevity and reliability of SCP Underground Facilities.

General Requirements

- Minimum Depth: **36"**
- Minimum Separation to Other Utilities: **12"**
- Minimum Conduit Strength: **SCH40 Electrical or Greater of Required Size**
- Minimum Separation to foundations and structures: **36"**
- Installation shall be in accordance with National Electric Safety Code, National Electric Code and SCP Electric Service Specification Requirements

General Installation Diagram

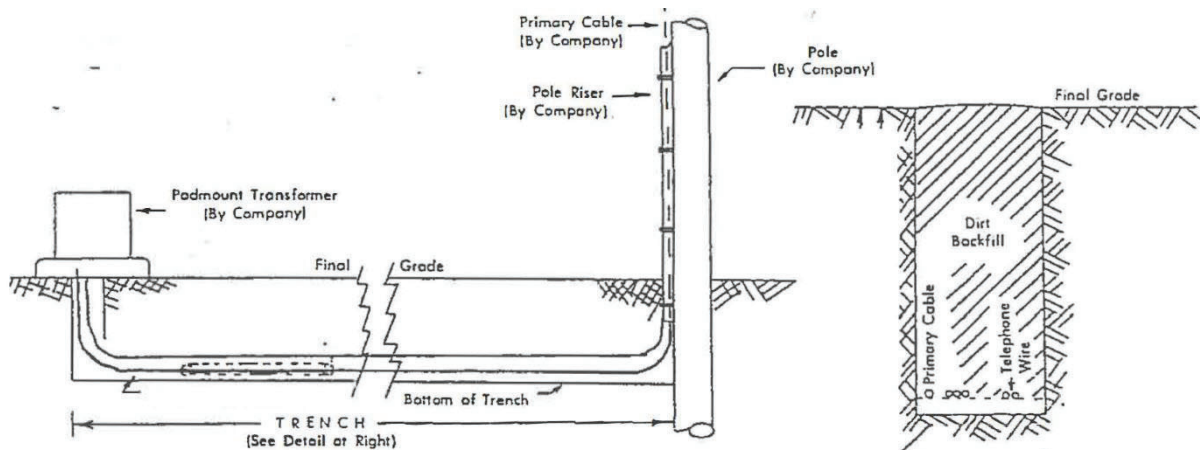

CALL BEFORE YOU DIG – OUPS 811

1-800-362-2764